

Before the Public Service Commission of Utah

In the Matter of the Investigation of the
Costs and Benefits of PacifiCorp's Net
Metering Program

Docket No. 14-035-114

Vote Solar Exhibit 1.0 (DT)

DIRECT TESTIMONY OF RICK GILLIAM

ON BEHALF OF

VOTE SOLAR

June 8, 2017

QUINN EMANUEL URQUHART
& SULLIVAN LLP
Jennifer M. Selendy
Daniel P. Mach
51 Madison Avenue, 22nd Floor
New York, NY 10010
Telephone: (212) 849-7000
Email: danielmach@quinnemanuel.com

WOOD BALMFORTH LLC
Mary Anne Q. Wood (USB#3539)
Stephen Q. Wood (USB# 12403)
60 East South Temple, Suite 500
Salt Lake City, UT 84111
Telephone: (801) 366-6060
Email: swood@woodbalmforth.com

Attorneys for Vote Solar

TABLE OF CONTENTS

1

2 INTRODUCTION 2

3 PURPOSE AND SUMMARY OF TESTIMONY 3

4 INTRODUCTION TO THE CHARACTERISTICS OF DISTRIBUTED SOLAR
5 GENERATION AND NET METERING..... 8

6 HISTORY OF THIS PROCEEDING AND INTRODUCTION OF WITNESSES..... 10

7 PROBLEMS AND CONCERNS WITH THE RMP SUBMITTAL AND PROPOSALS..... 14

8 A. Rooftop solar customers should not be segregated into a separate rate class. 15

9 B. Rooftop solar customers should not be subject to demand charges. 21

10 VOTE SOLAR PROPOSAL FOR RATE DESIGN AND COMPENSATION FOR
11 ROOFTOP SOLAR CUSTOMERS OF RMP..... 33

12

13 **INTRODUCTION**

14 **Q: Please state your name and business address.**

15 A: My name is Rick Gilliam. My business address is 590 Redstone Drive, Suite 100,
16 Broomfield, CO 80020.

17 **Q: By whom are you employed and in what capacity?**

18 A: I am the Program Director, DG Regulatory Policy for Vote Solar, a non-profit
19 organization working to foster economic opportunity and mitigate climate change by
20 bringing solar energy into the mainstream. Since 2002, Vote Solar has engaged in state,
21 local and federal advocacy campaigns to remove regulatory barriers and implement key
22 policies needed to bring solar to scale. Vote Solar is not a trade organization, nor does it
23 have corporate members. Vote Solar has approximately 140 members in Utah, many of
24 whom are customers of Rocky Mountain Power (RMP).

25 **Q: On whose behalf are you testifying?**

26 A: I am testifying on behalf of Vote Solar.

27 **Q: Please provide your professional experience and qualifications.**

28 A: I have been with Vote Solar since January of 2012 overseeing policy initiative
29 development and implementation particularly as it relates to distributed solar generation
30 or “DSG.” Prior to joining Vote Solar, my regulatory and policy experience included
31 five years in the Government Affairs group at Sun Edison, one of the world’s largest
32 solar developers at the time, as a manager, director and eventually vice president; twelve
33 years with Western Resource Advocates as Senior Policy Advisor; and twelve years in

34 the Public Service Company of Colorado (PSCo or the Company) rate division as
35 Director of Revenue Requirements. Prior to that, I spent six years with the Federal
36 Energy Regulatory Commission (FERC) as a technical witness (engineer). All told, I
37 have nearly 40 years experience in utility regulatory matters.

38 I have a Masters Degree in Environmental Policy and Management from the University
39 of Denver in Denver, Colorado, and a Bachelor of Science Degree in Electrical
40 Engineering from Rensselaer Polytechnic Institute in Troy, New York. My curriculum
41 vitae is appended to this testimony as Vote Solar Exhibit 1.1.

42 **Q: Have you testified previously before this Commission?**

43 A: Yes, I have (in Docket Nos. 01-035-10 and 99-035-10). More recently, I testified in
44 RMP's most recent rate case Docket No. 13-035-184 on the solar surcharge proposed by
45 RMP, the case which ultimately led to the filing of the compliance filing at issue in this
46 proceeding. I have also testified in proceedings before the Arizona Corporation
47 Commission, the Public Utilities Commission of Colorado, the Idaho Public Utilities
48 Commission, the Nevada Public Utilities Commission, the New Mexico Public
49 Regulation Commission, the Wisconsin Public Service Commission, the Wyoming
50 Public Service Commission, and the Federal Energy Regulatory Commission.

51

52 **PURPOSE AND SUMMARY OF TESTIMONY**

53 **Q: What is the purpose of your testimony?**

54 A: The purpose of my testimony is to address the requests by RMP to segregate residential
55 customers with rooftop solar resources into a new customer class, and to impose a new

56 rate structure and design that amounts to a large new fixed charge for rooftop solar
57 customers. In addition, I will introduce the other Vote Solar witnesses and the topics
58 addressed in their testimony.

59 **Q: Please summarize your testimony.**

60 A: In my testimony, I provide some background information and relevant resources for the
61 Commission to consider in evaluating the proposals by RMP. I then challenge RMP's
62 proposals and requests in this proceeding beginning with the mischaracterization of the
63 attributes of residential rooftop solar customers that results in its recommendation to
64 segregate this subset of residential customers into a separate rate class. My testimony,
65 along with the analyses performed by Dr. DeRamus, demonstrates that rooftop solar
66 customers load characteristics are not significantly different from those of the general
67 body of residential customers and provide no basis for separation of this group.
68 Moreover, segregating customers into subclasses of service based upon the type and
69 extent of customer-side-of-the-meter energy technologies is unprecedented, could lead to
70 other subdivisions of the residential class (e.g. type of air conditioning equipment used),
71 would be detrimental to other DER technologies, and potentially harm low-income
72 customers.

73 I then show that the RMP proposed rate design is inappropriate, discriminatory, and
74 tantamount to a straight fixed-variable rate structure. It is my view that RMP has not
75 provided evidence that the current low levels of penetration of rooftop solar in RMP's
76 residential customer groups, particularly taking into account the results of the cost and

77 benefit analysis performed by Mr. DeRamus, justify a major change in rate design and
78 structure under Utah Code § 54-15-105.1 at this time.

79 Specifically, I discuss the concerns and problems with the use of a demand charge,
80 notably its lack of connection with cost causation, and its inability to provide an
81 actionable price signal to customers. I recommend rejection of RMP's proposed demand
82 charge structure. In addition, RMP's proposal to shift distribution cost recovery to the
83 monthly customer charge runs afoul of cost recovery principles (the customer charge
84 recovers the cost of *connecting* to the grid, but not the grid itself) and results in a 150%
85 increase. This increase is not justified and should be rejected under any circumstance.

86 In recognition of the concerns of the utility and other stakeholders about the recent
87 growth rates of residential solar customers however, I recommend that if any changes are
88 made to the Net Energy Metering (NEM) program in Utah, the Commission should adopt
89 a principle of gradualism to ensure that an abrupt shift in rates does not cause adverse
90 effects on NEM customers, Utah ratepayers generally, and to the public policies of the
91 state of Utah. Vote Solar proposes a series of structural changes that reflects the principle
92 of gradualism by phasing in the evolution of the NEM program. I propose three phases,
93 or groups of NEM customers, based upon the timing of the solar customer's
94 interconnection application. The three groups would be current NEM customers,
95 transitional solar customers, and future solar customers. I recommend that the first group
96 be subject to a continuation of the current rate structure, including the netting of excess
97 energy under existing net metering policy and crediting customer's exports at the
98 residential retail energy rate and allowing for carry-forward of net excess energy to future

99 months, for a reasonable period of time to ensure that customers who committed
100 substantial investments based on existing policies are not subject to economic hardship.
101 The transitional solar customers are those residential customers that submit an application
102 for interconnection after the current customer group is closed.¹ These customers would
103 be subject to a “net billing” arrangement in which netting of self generation with
104 consumption is limited to the monthly billing period, and any net excess generation at the
105 end of the month is compensated at a rate tied to the total aggregate retail rate or “TARR”
106 (total residential revenue divided by total residential kWh sales for most recent calendar
107 year) that declines over time based on the penetration levels of residential solar
108 experienced by RMP in its Utah service territory. Under Vote Solar’s proposal, this
109 percentage of TARR would decline as certain milestones of distributed solar penetration
110 are achieved to address the uncertainty regarding the underlying cause of recent growth
111 rates, i.e. whether normal or a “gold rush” based upon anticipated policy changes in this
112 proceeding and the phase out of the state tax credit. If penetration continues to grow to
113 the 20% (of the 2007 peak load) overall NEM cap established by the Commission, the
114 compensation for monthly net exports should decline to a minimum floor rate. I believe a
115 reasonable floor is essential to fairly compensate rooftop solar customers for the
116 minimum benefits provided by their distributed solar resources under a high penetration
117 scenario. This mechanism acts as a throttle on the economics for customers seeking to
118 deploy rooftop solar, mitigating concerns the Commission might have over rapid
119 adoption of solar and the potential future impacts of a very high level of residential
120 distributed solar on the grid.

¹ Specific dates defining the three groups of customers are discussed in more detail below.

121 Finally, I believe that a long-term rate design should be piloted during this period, refined
122 and implemented at a future date for future customers, based on information gathered
123 during that period. To provide sufficient time to evaluate alternative rate designs, I
124 recommend that the Commission target 2025 for the implementation of this new rate
125 design. Based on the current state of knowledge, I recommend a time-of-use (TOU) rate
126 structure, with consideration for low-income customers, be evaluated through one or
127 more pilot programs between the close of this proceeding and 2025. In late 2023 to early
128 2024, RMP should consult with stakeholders and file a proposal for a TOU rate structure
129 including pricing and time periods and any other details necessary for its implementation
130 the following year. I recommend this be the mandatory structure for all residential
131 customers

132 I believe this staged set of recommended changes properly phases in any changes to the
133 current net metering program and addresses the concerns of RMP and other stakeholders,
134 while continuing to provide an opportunity for customers to determine their own energy
135 future. At the same time, the solar industry will continue to have a market in Utah as the
136 economics for customers will change in a predictable and sustainable fashion for the
137 foreseeable future.

138 **Q. Do you have any other recommendations for this Commission?**

139 A. Yes. Stakeholders in Utah have spent the last several years addressing issues and
140 concerns related to rooftop solar generation and net metering. But distributed solar
141 generation is one of a myriad of new technologies that are changing or will change the
142 way we think about energy production, its use and fungibility. Efficiency technologies

143 have been around for some time and continue to improve. Other distributed energy
144 resource (DER) technologies including demand response, storage, electric vehicles, and
145 combined heat and power are continually improving in cost-effectiveness, and have the
146 potential to make energy services for all customers more efficient and more affordable.
147 Indeed, while some DER technologies generate energy on-site and reduce consumption
148 of grid-supplied energy, others consume energy (e.g. replacing gasoline vehicles with
149 electric), some provide ancillary services, and still others can shift the timing of
150 consumption. Combined, new technologies have the potential to flatten consumption
151 profiles of utility customers, or even to reduce consumption specifically during higher
152 cost hours.

153 RMP's proposal in this proceeding would effectively put an end to the rooftop solar
154 industry in Utah, as similar proposals have done in Nevada and in the territory of Salt
155 River Project in Arizona. I urge the Commission to keep in mind that rooftop solar is the
156 first of many technologies that utilities may believe, on the surface, is detrimental to their
157 current business model. This Commission must guard against reactionary responses to
158 new technologies as they become available (such as proposing new charges or new rate
159 structures for each new technology), and balance a viable market for rooftop solar (and
160 other DER technologies) with a financially viable utility.

161 Vote Solar's proposal in this proceeding provides this balance.

162 **INTRODUCTION TO THE CHARACTERISTICS OF DISTRIBUTED SOLAR**
163 **GENERATION AND NET METERING**

164 **Q: What is distributed solar generation or DSG?**

165 A: DSG is solar electric generation (usually photovoltaic or PV) connected to the utility grid
166 in relatively small sizes at the distribution level. Most often DSG is located on-site at a
167 customer's premises, a.k.a. "rooftop solar," although in some states Community Shared
168 Solar (CSS) is gaining popularity. CSS projects are larger, somewhat more centralized
169 PV systems connected to the distribution grid from which retail customers acquire
170 ownership shares or subscriptions, and pay a delivery charge in most cases to receive the
171 power. For example, RMP's subscription solar program embodied in Tariff Sheet 73 is an
172 example of a community solar project. Customer-sited rooftop solar DSG is most often
173 deployed under a net metering arrangement, as it is on RMP's system.

174 The amount of energy generated at any one time can be (1) zero (at night), (2) less than
175 the consumption of the host customer, or (3) more than the host customer's consumption.
176 In the third case, electricity generated by the on-site DSG leaves the premises and
177 supplies neighboring customers. It is this aspect of net metering, the export component,
178 that is unique in comparison to other behaviors or vehicles customers may use to reduce
179 consumption from the utility.

180 **Q: Please describe the solar generation exported off site.**

181 A: Exported energy reduces the loading on the local distribution grid by supplying locally
182 generated energy to a neighboring retail customer. This happens instantaneously and
183 typically such energy flows to neighboring customers who are on the same secondary
184 circuit, without passing through any transformers. The flow of this energy causes no
185 incremental cost to the utility. Nor does it impose any burden of grid management on the
186 utility. Indeed, the utility has no control over the flow, is not required to re-dispatch it in

187 any way, and is generally unaware that it has happened. For example, if a customer is
188 generating 5kW with its system but is only using 4 kW, the other kilowatt leaves the
189 home and serves the non-solar neighbor. The utility only sees a load at that point in time
190 on the circuit (if it is metered), but does not know the mix of loads and generation
191 sources, nor that the total load on the circuit has been reduced by 5kW. Moreover, the
192 extra kilowatt reduces the load on the distribution system at a time of generally higher
193 utility costs in the middle of the day – a benefit for all.

194 Next door, the neighboring non-solar customer sees nothing different. She does not know
195 whether the electricity she is consuming came from the utility or her solar neighbor.
196 Either way, she pays full retail price for the electricity to the utility. Thus the utility
197 recovers full retail revenue for solar electricity that is exported to the neighbor.

198

199 **HISTORY OF THIS PROCEEDING AND INTRODUCTION OF WITNESSES**

200 **Q: Please describe the history of this proceeding?**

201 A: The relevant history of net metering begins in 2002 with the passage of House Bill 7. The
202 Utah legislature authorized the NEM program based on its express finding that the NEM
203 program would promote Utah’s policy of favoring residential solar energy generation:
204 “The bill strikes a fair balance between the *need to encourage consumer generation* and
205 the electrical corporations’ need to plan for various load levels.” Jan. 31, 2002
206 Testimony of Bill Sponsor Representative Gordon Snow Introducing Bill HB0007, “Net

207 Metering of Electricity.”² This finding highlights the goal of state policy to not simply
208 allow customer generation, but to encourage it. This view is consistent with the concept
209 of providing energy choices to the citizens of Utah so that each is empowered to
210 determine their own future when it comes to energy.

211 In 2014, Senate Bill 208 (Utah Code Annotated § 54-15-105.1) (“SB 208”) was passed
212 and signed into law. The Commission has described the two components as Subsection
213 One and Subsection Two, as follows:

- 214 • Subsection One:
215 Determine, after appropriate notice and opportunity for public comment, whether
216 costs that the electrical corporation or other customers will incur from a net metering
217 program will exceed the benefits of the net metering program, or whether the benefits
218 of the net metering program will exceed the costs; and
- 219 • Subsection Two:
220 Determine a just and reasonable charge, credit, or ratemaking structure, including
221 new or existing tariffs, in light of the costs and benefits.

222 In the Commission Order³ concluding the RMP GRC in progress at the time of passage
223 of SB208, the Commission rejected a net metering facilities charge proposed by RMP
224 based on a lack of adequate evidence, concluding that “the testimony and comments
225 (both written and verbal) provided in this proceeding fall short of providing the
226 Commission the substantial evidence necessary to make the determinations required
227 under Utah Code Ann. § 54-15-105.1(1)”⁴ (Order at 58-59). The Commission went on to
228 conclude the better course is for stakeholders to “gather and analyze the necessary data,
229 including the load profile data that is foundational to this analysis, and present to us their
230 results and recommendations in a future proceeding.” (Order at 67). The Commission

² http://utahlegislature.granicus.com/MediaPlayer.php?clip_id=9778&meta_id=437046.

³ Docket No. 13-035-184 Report and Order, Issued August 29, 2014.

⁴ Subsection one of SB208.

231 then established this docket in which to examine the costs and benefits of PacifiCorp’s
232 net metering program (Order at 69).

233 The instant proceeding began with a technical conference on November 5, 2014, and was
234 followed by a series of technical conferences and workshops in 2015 in which
235 stakeholders met and discussed matter relevant to SB208 and the Commission’s August
236 2014 Order. Hearings were held in October 2015 and the Commission issued an Order on
237 November 10, 2015 (“Nov 2015 Order”) to which RMP’s compliance submittal of
238 November 9, 2016 responds.

239 **Q. Please explain your understanding of the Commission’s Nov 2015 Order.**

240 A. The Commission’s Nov 2015 Order established a general framework for assessing the
241 costs and benefits of net metering. The Order essentially requires PacifiCorp (RMP) to
242 submit two costs of service – one with and one without – net metering customers.
243 Additionally, the Commission required the Company to utilize a test period in these
244 studies “commensurate with the test period in PacifiCorp’s next general rate case.”
245 (Order at 7, 8 and 16). The Commission has since defined “commensurate” to mean
246 “corresponding in size, extent, amount, or degree.”⁵ Finally, the Commission was clear
247 as to the treatment of excess energy: “In preparing the ACOS, PacifiCorp should not
248 assign a price or value to the net metering customers’ excess energy other than as
249 recognized in the net power cost analysis. We will consider issues related to how net
250 metering customers should be credited or compensated for their excess energy when we
251 take up the Statute’s rate setting implications under Subsection Two.” (Order at 9). “The

⁵ Consolidated Order Denying Dispositive Motions, February 23, 2017, page 10.

252 framework ... leaves some details unspecified” and “some issues remain to be resolved.”
253 (Order at 4).

254 **Q. Please describe the requests of RMP in this proceeding.**

255 A. On November 9, 2016, RMP submitted a compliance filing responding to the
256 Commission’s Nov 2015 Order that included its actual cost of service (ACOS: including
257 net metering) and its counterfactual cost of service (CFCOS: no net metering) studies,
258 and a separate NEM breakout cost of service based on calendar year 2015. The Company
259 requests⁶ the Commission:

- 260 (1) Find that the CFCOS, the ACOS, and the net metering breakout cost of service
261 study (“NEM Breakout COS”) are compliant with and fulfill the November 2015
262 Order;
- 263 (2) Find, based on the cost of service analyses, that the costs of the net metering
264 program under the current rate structure exceed its benefits;
- 265 (3) Find, based on the cost of service analyses, that the unique usage characteristics
266 of net metering customers justify segregating them into a distinct class;
- 267 (4) Determine that the current rate structure for net metering customers is unjust and
268 unreasonable because it does not reflect the costs imposed on and benefits
269 contributed to the system, and unfairly shifts costs from net metering customers to
270 other customers;
- 271 (5) Approve, as just and reasonable, the Company’s proposed Schedule 136, Net
272 Metering Service, with modifications to net metering service and Schedule 5,
273 Residential Service for Customer Generators, which includes a three-part tariff
274 structure that reflects the costs and benefits that net metering customers impose on
275 and contribute to the system; and
- 276 (6) Approve a waiver of Utah Admin. R. 746-312-13, pursuant to Utah Admin. R.
277 746- 312-3(2) for changes to the application fee, as explained in more detail
278 [therein].

279 **Q. Please describe the subject matter of the witnesses Vote Solar presents in this**
280 **proceeding.**

⁶ Compliance Filing, page 2.

281 A. Dr. David DeRamus presents testimony on behalf of Vote Solar addressing the three
282 costs of service (CFCOS, the ACOS, and NEM breakout), the costs and benefits of the
283 net metering program, and the data underpinning the usage characteristics of net metering
284 customers. He also discusses the effect of the Company's proposals on its financial risk.
285 In addition, Dr. DeRamus addresses the benefits to all customers of a more competitive
286 marketplace that allows customers to choose different energy savings and supply options,
287 and fosters innovation. Finally, he addresses concerns with the RMP proposed rate design
288 and discusses alternative options.

289 **PROBLEMS AND CONCERNS WITH THE RMP SUBMITTAL AND**
290 **PROPOSALS**

291 **Q. Please provide an overview of the errors Vote Solar has found with the RMP**
292 **submission that is the subject of this proceeding.**

293 A. RMP's filing raises many substantive and policy concerns for Vote Solar. Dr. DeRamus
294 and I will address the following:

- 295 1. Data and analytical errors and inconsistencies within the cost of service studies,
296 including the failure of RMP to demonstrate that current rates do not adequately
297 recover the cost of service from residential rooftop solar customers;
- 298 2. Overstatement of the costs and understatement of the benefits provided by net
299 metering customers;
- 300 3. Failure of RMP to take into account the financial "de-risking" that occurs as a
301 result of the effect of its rate proposals on its revenue stream;
- 302 4. The general failure of RMP to consider the benefits of customer choice and
303 innovative technologies that provide improved service at a lower cost;

304 5. The failure of RMP to adequately demonstrate that the subgroup of residential
305 customers with rooftop solar have characteristics materially different than those of
306 other subgroups or the residential class as a whole, resulting in a lack of
307 justification for a separate rate class.

308 6. The failure of RMP to demonstrate that demand charges for residential rooftop
309 solar customers are just and reasonable; and

310 7. The failure of RMP to demonstrate that the fixed monthly charge it proposes for
311 NEM customers is just and reasonable.

312

313 **A. Rooftop solar customers should not be segregated into a separate rate class.**

314 **Q. Please explain why you believe RMP has failed to justify the segregation of rooftop**
315 **solar customers into a separate rate class.**

316 A. RMP bases its justification of segregating this group of rooftop solar customers on three
317 basic rationales: the usage characteristics of rooftop solar customers differ from other
318 residential customers, NEM customers use the grid more than other customers because
319 they both import and export electricity, and peak solar generation does not coincide with
320 the time of the Company's peak load thus has a modest ability to reduce peak load.⁷

321 **Q. Please describe the bases for the usage characteristic differences identified by RMP.**

322 A. The difference in usage characteristics is described in detail in the Company's testimony
323 (Steward at 325-374), and can be summarized as the following two discrete items:

⁷ Direct Testimony of Gary Hoogeveen, lines 189-195.

- 324 ○ Customers with rooftop solar have a different load profile but not necessarily a
325 different peak demand requirement (lines 325-328), and their reduced usage also
326 results in lower load factors than for other residential customers (lines 341-343);
327 and
328 ○ Net metering customers use the system differently [than low-use customers] since
329 they use the energy grid to both receive and to export energy (lines 357-361).

330 The Company's first point addressing the relationship between customer consumption
331 and maximum demand relates to cost allocation. Because fixed costs are allocated on the
332 basis of the aggregated class demand at the time of the system peak demand, reduced
333 usage without reduced demand (i.e. lower load factors) could result in the same fixed cost
334 responsibility to the group of customers, but with fewer kWh to spread those costs over,
335 resulting in a rate increase, all else equal. In other words, lower load factor customers
336 generally cost more to serve than higher load factor customers.


337 **Q. Are the load factors for rooftop solar customers different than the load factors for**
338 **residential customers in general?**

339 A. No, they are not. RMP provided load factor data in response to discovery from the DPU.⁸
340 The load factors for the general body of residential customers, as represented by the 196
341 load research customers, and those for the 52 rooftop solar customers (for which data is
342 available) is depicted in Figure 1 below and evaluated further in the testimony of Dr.
343 DeRamus.

⁸ Response to DPU4-3.

344

Figure 1: Comparison of Load Factors

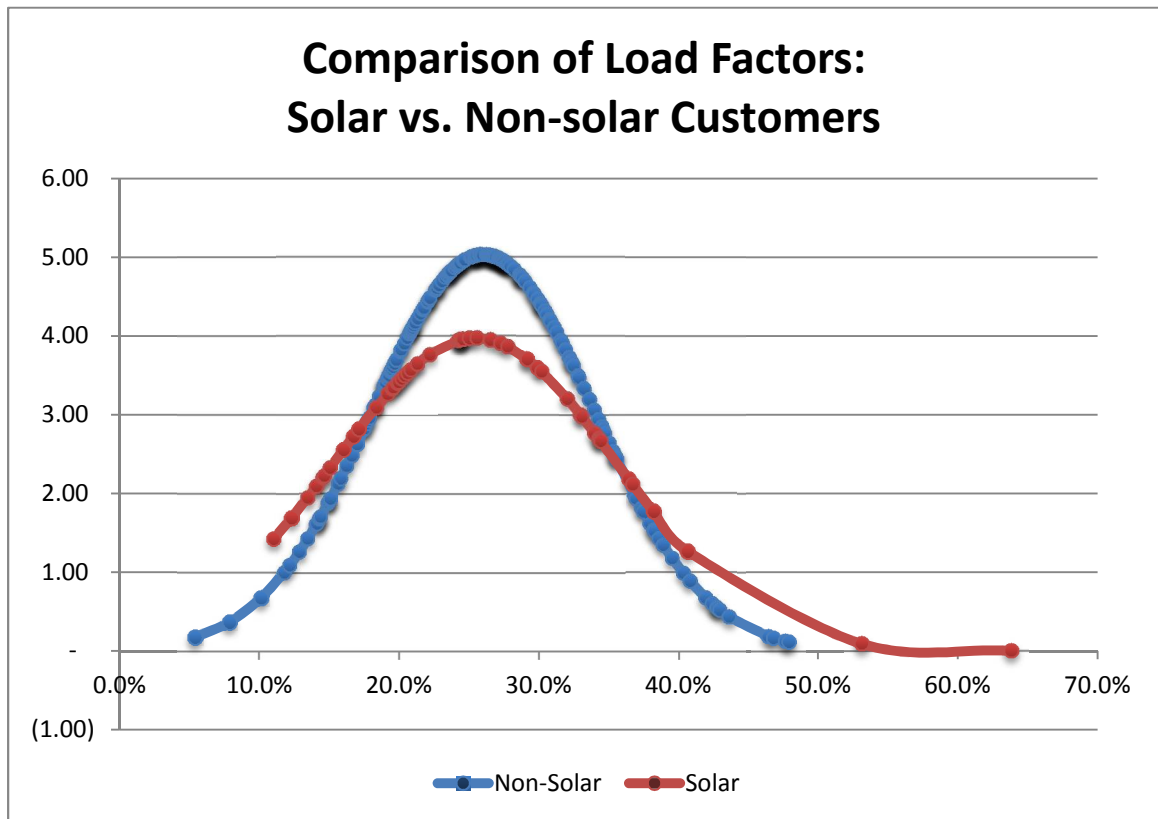

345

346

347

348

349

350

351

352

353

354

The range of load factors for solar customers is not significantly different than the range for non-solar customers. This relationship is born out by the adjusted NEM breakout cost of service developed by Dr. DeRamus which demonstrates that the cost to serve rooftop solar customers is not meaningfully different than the cost to serve non-solar customers.

These two factors clearly demonstrate that the usage characteristics of solar customers, particularly how such characteristics may affect utility costs and cost allocation, are not very different than non-solar customers.

Q. Please describe your evaluation of RMP's assertion that rooftop solar customers use the system differently than other residential customers.

355 A. The Company notes that solar customers “use the energy grid not only to receive energy
356 from the Company’s facilities, but also to export energy they produce to the Company’s
357 system.”⁹ This matter of physics, in and of itself, does not result in any additional costs
358 particularly at the current low penetration rate.

359 However, the Company describes concerns¹⁰ it has during certain times of year when
360 solar generation is relatively high and customer usage may be low, e.g. the springtime as
361 follows:

362 To handle the higher level of energy flow experienced in the spring months, the local
363 distribution system must be sized to accommodate the greater of the two values.
364 Consequently, the system may be sized up to 30 percent greater than normal. In a few
365 cases, the reverse power flow could approach 50 percent more as compared to the
366 customers’ peak load demand.

367 If a customer installs the level of rooftop solar required to offset all of their energy
368 usage, including conversion of their gas appliances and gasoline vehicles to electric,
369 the magnitude of exported energy demand can be much greater and the reverse flow
370 effect becomes even more dramatic.

371 **Q. Has the Company demonstrated that it has sized the distribution system to**
372 **accommodate loads 30% greater than normal?**

373 A. No, it has not. In fact it appears the 30% figure refers to a later discussion in the
374 Company testimony addressing the absolute value of energy flowing into and out of the
375 customer’s premises for a net-zero customer (Marx at 110-116). The Company claims it
376 must “manage” a 134% higher level of energy on behalf of the customer.¹¹ In reality, the

⁹ Steward at 359-361.

¹⁰ Marx at 73-81.

¹¹ Note that the 134% (line 113) derived by Mr. Marx is the result of dividing the absolute value of the two way flow, 11,558 kWh, for a net zero solar customer by the typical non-solar customer consumption of 8,601 kWh. The former figure is not 134% higher than the latter, but only 34% higher.

377 Company does not manage the excess energy but rather the energy flows to the nearest
378 load, likely a neighbor on the same secondary system. The Company does not provide
379 any data supporting its assertion that “reverse flows” exist at the point where they might
380 affect Company infrastructure – at the secondary transformer, nor does it establish any
381 significant number of rooftop solar customers who have sized their systems for *net-zero*
382 consumption of grid-supplied energy.

383 **Q. Has the Company experienced reverse power flows approaching 50% of the**
384 **customer’s peak load demand?**

385 A. The Company has provided no data to support that assertion.

386 **Q. Does the typical solar customer of RMP size their PV system to offset 100% of their**
387 **annual load?**

388 A. No, it does not. Thus, RMP’s 30% “reverse flow” figure is a hypothetical example based
389 on a type of customer that is rare and not representative of a typical NEM customer.

390 **Q. If additional equipment is required to accommodate distributed generation, who**
391 **pays for it?**

392 A. The NEM customer whose system necessitates the equipment pays, not the utility or
393 other residential customers. Mr. Marx states additional equipment may be required to
394 accommodate increasing levels of distributed generation (lines 84-91). Mr. Marx notes
395 later that “[i]f the engineering review shows that system issues will occur, in accordance
396 with applicable Commission rules, the customer must pay for the necessary corrections

397 before her application is approved and before we will interconnect the generation
398 system.”

399 **Q. How often does the excess energy that is not used immediately on-site cause reverse**
400 **power flows at the secondary transformer?**

401 A. The Company has provided no data to demonstrate the degree, if any, to which exports
402 cause reverse power flows from the secondary system.

403 **Q. If the exported energy doesn't typically leave the secondary distribution system,**
404 **where does it go?**

405 A. As noted above, in most cases the excess energy from one solar home flows to serve the
406 nearest load, most likely within the secondary distribution system. RMP is paid by the
407 customer receiving the solar-generated energy at the regular retail rate which includes the
408 fixed costs of production, transmission, and distribution. Each residential secondary
409 circuit serves a small number of customers, generally fewer than 10. Thinking of the
410 secondary circuit as a system comprised of loads and resources, the sum of solar
411 generation from the solar home(s) would have to exceed the total consumption of all the
412 homes on that circuit in order for reverse power flows to occur beyond the transformer.
413 There are hypothetical situations that can be devised that would achieve such an outcome,
414 but hypotheticals are not grounded in the reality necessary and appropriate when we are
415 discussing in this proceeding the alleged need for major rate structure changes that could
416 decimate the solar industry. The bar for such demonstrated evidence should be high.

417 **Q. Are there other reasons why rooftop solar customers should not be segregated into a**
418 **separate class?**

419 A. Yes. When the NEM breakout cost of service is corrected to exclude behind the meter
420 consumption of on-site generated solar energy as a cost as Dr. DeRamus has done, the
421 cost of service analysis shows that rooftop solar customers pay approximately the same
422 proportion of the utility's total costs as do other non-solar residential customers. This is
423 not a surprising outcome given the correlation of the load factors between solar and non-
424 solar customers. As a result, there is absolutely no cost basis for segregating rooftop solar
425 customers into a separate class with a separate and punitive rate structure.

426

427 **B. Rooftop solar customers should not be subject to demand charges.**

428 **Q. Please explain RMP's proposed rate structure for rooftop solar customers.**

429 A. RMP is proposing a three part rate structure based on its belief that such a structure
430 accounts for the unique load characteristics of residential rooftop solar customers, ensures
431 solar customers pay their fair share of fixed costs for infrastructure and backup grid
432 reliability, and matches the costs to the customers that cause them.¹²

433 The proposed structure reflects a much higher monthly fixed customer charge, a demand
434 charge based on the highest 60 minutes of use during on-peak hours during the month,
435 and a much smaller energy charge with no differentiation for consumption. RMP's
436 proposal compares to the current rates as follows:

¹² Hoogeveen 201-205.

	Residential Rate Schedule 1	Proposed Rate Schedule 5
Monthly Customer Charge	\$6.00	\$15.00
Energy Charge		3.8143 ¢/kWh
<u>May-Sept</u>		
1st 400 kWh	8.8498 ¢/kWh	
Next 600 kWh	11.5429 ¢/kWh	
All Add'l kWh	14.4508 ¢/kWh	
<u>Oct-Apr</u>		
1st 400 kWh	8.8498 ¢/kWh	
All Add'l kWh	10.7072 ¢/kWh	
Demand Charge		\$9.02 per kW

437

438 **Q. Does the Company provide adequate support for the 150% increase in the monthly**
439 **customer charge?**

440 A. No. The Company indicates that “[t]he monthly customer charge of \$15.00 is designed to
441 recover costs related to customer services and certain components of the distribution
442 system, specifically service lines, meters, and line transformers.”¹³ It suggests that
443 rooftop solar customers “place additional burdens and reliance on these local facilities
444 since they use them for both taking service from the Company and to export their excess
445 generation output to the grid.” (Steward 477-479). RMP goes on to say “it would not be
446 appropriate to reflect local distribution costs in the energy credit received by net metering
447 customers for excess energy.” (Steward 484-486). In other words, the rationale for
448 including transformers in the customer charge is to assure that rooftop solar customers
449 continue to pay for these transformers even when their excess energy would otherwise
450 reduce their energy charge and thus their bill.

451 **Q. Why is this justification inadequate, in your opinion?**

¹³ Steward 403-405

452 A. Energy generated by rooftop solar that exceeds the host customer's use flows to a
453 neighbor's house rarely if ever moving upstream past the transformer. Therefore, it
454 reduces the loading on the transformer (and other upstream facilities) and extends the
455 equipment's life. This benefit is shared by all residential customers, but is not reflected in
456 the proposed rate structure. Instead, RMP assigns a pro-rata share of these facilities
457 regardless of how much or how little the solar customer uses them.

458 Moreover, under the Company's proposed rate structure, the credit received by the NEM
459 customer would not include anything other than variable expenses. The customer would
460 receive no credit for any benefit of reduced loading on the facilities at issue. At the same
461 time, as the neighboring customer that physically consumes the solar-generated energy
462 pays the utility for its consumption, included is the full retail rate times the energy
463 received from the solar neighbor. Thus the Company receives compensation for any
464 excess energy at the retail rate, including the embedded costs of generation, transmission,
465 and distribution, but under its proposal here would only pay the solar generating customer
466 a fraction of that amount.

467 There is no need to include the cost of "certain components of the distribution system" in
468 the monthly service charge and indeed would produce a windfall for the Company. This
469 change should be rejected.

470 **Q. Do you agree the proposed rate structure ensures solar customers pay their fair**
471 **share of fixed costs for infrastructure and backup grid reliability, and matches the**
472 **costs to the customers that cause them?**

473 A. No, I do not. As demonstrated above, the residential class is comprised of a diverse set of
474 customers, each with its own unique load characteristics from which the rooftop solar
475 customers' profiles do not differ significantly. The Company's rationale, if true, could be
476 said to apply to every individual residential customer.

477 If the Company believes that demand charges ensure payment of a fair share of fixed
478 costs, then the same reasoning would hold true for all residential customers. Put another
479 way, a rate structure that purportedly matches costs with the customers that cause them as
480 the Company argues would, in theory, be equally effective for more accurate revenue
481 collection from the general body of residential ratepayers. RMP's proposal of such a rate
482 only for NEM customers suggests that it recognizes the punitive nature of a demand
483 charge, and seeks to impose it solely on NEM customers to discourage DSG adoption.

484 **Q. Does RMP suggest that the demand charge structure be applied to any residential**
485 **customers other than rooftop solar customers?**

486 A. No, it does not.

487 **Q. Do you support demand charges for the general body of residential ratepayers?**

488 A. No, I do not. RMP proposes to measure maximum demand over a 60 minute interval
489 (Steward 549) during the Company's on-peak periods of 3:00 to 8:00 p.m. during the
490 months of May to September, and 8:00 to 10:00 a.m. and 3:00 to 8:00 p.m. during the
491 months of October through April, for non-holiday weekdays. (Steward 416 to 420). This
492 amounts to approximately 100 hours per month in the summer and 140 hours per month
493 in the winter. The Company also points out that about 63% of its costs are demand
494 related. (Steward Table 5 @ 375) Thus, nearly two-thirds of a customers bill will be tied

495 to a single unspecified hour out of 100 each month, or 1%, in the summer time while in
496 the winter it is 1 out of 140 hours. Each customer's bill is enormously impacted by its
497 load in whichever random 60 minute period its maximum billing demand occurs,
498 regardless of any coincidence with the peak demand of the system. Because a customer's
499 individual peak billing demand can occur during any of the 100 or 140 hours per month
500 and not necessarily during the hour when system costs are greatest or system peak
501 demand is highest, the demand charge does not reflect cost causation.

502 **Q. Please explain why RMP's proposed demand charge does not reflect cost causation.**

503 A. Because of their diversity in energy usage, customers' individual non-coincident
504 maximum loads, even if limited to specific bands of hours, would only occur at the same
505 time as the peaks on the system as a whole, or at the same time as peaks on the local
506 distribution system, by chance or coincidence.

507 **Q. Doesn't the limitation to on-peak hours increase the likelihood that customers will**
508 **respond to the demand charge, and reduce their usage during those periods, and in**
509 **turn utility costs?**

510 A. It is quite possible a customer might work hard to reduce consumption during the
511 applicable times, but it would need to be vigilant every non-holiday weekday during the
512 specified hours. It would only take a single mistake by the customer to ruin an otherwise
513 diligent effort on behalf of the customer, resulting in a large demand charge for the entire
514 month. For example, having a few friends over on a warm Friday night could result in a
515 new peak demand.

516 Moreover, without additional in-home technologies, a customer would not know if it set a
517 new peak demand and therefore could not effectively respond to the price signal the
518 Company says a demand charge would create. And even if the customer does establish a
519 high demand early in the month, she cannot let down her guard as there is no guarantee
520 she may not set an even higher demand later in the month. Alternatively, if the customer
521 believes it set its peak demand early in the month upon which two-thirds of its bill will be
522 based, she may be complacent about trying to minimize consumption during peak hours
523 for the rest of the month. These unintended consequences can exasperate the efforts of
524 utilities to keep consumption and costs down during peak periods.

525 **Q. The Company indicates that the proposed rates provide a price signal to customers**
526 **to encourage more efficient use. Do you agree?**

527 A. No. For a charge to be an effective price signal, a customer must have foreknowledge of
528 the signal, i.e. when it will occur, and the ability to respond through behavioral or
529 technological means. Many residential customers have limited choice or control over
530 when they use appliances. For example, electric furnaces and water heaters can consume
531 significant levels of electricity, with common models drawing 10.5 kW and 4.5 kW,
532 respectively. Air conditioners draw from 2 kW for a one-ton capacity model to as much
533 as 9 kW for a five-ton model. In addition, common hair dryers typically draw 1 kW and
534 often more; the average microwave or toaster oven can draw 1 kW; and an electric kettle
535 can draw 1 kW.

536 While families may be able to understand *how* this peak demand occurs, school and work
537 schedules may allow little flexibility to do anything about the timing of consumption.

538 Further, some of these devices are designed to be automatically controlled by thermostats
539 that would be difficult to override on a short-term basis to avoid demand charges. The
540 Company says that both staggering and reducing appliance use during on-peak periods
541 responds to the price signal. (Steward 447-449). These behavioral suggestions do not
542 respond to the demand price signal, but rather to the peak time periods themselves.

543 **Q. Has the Company considered TOU energy rates for rooftop solar customers?**

544 A. Yes, it has. It rationalizes not using TOU rates because rooftop solar customers would be
545 “over-compensated for their excess energy.” (Steward 563-564). However, the point of
546 TOU rates is to more closely reflect the higher utility costs during on-peak periods and
547 send the signal that the value of reducing energy consumption is higher. Therefore, any
548 additional energy put on the secondary system for consumption by neighboring
549 customers clearly has greater value, and should be compensated at the higher rate. This
550 will be discussed in more detail in Vote Solar’s proposed forward-looking rate structure.

551 **Q. Does the Company make other suggestions as to how customers may be able to**
552 **respond to its proposed demand charge rate?**

553 A. Yes. The Company suggests the following opportunities for rooftop solar customers to
554 respond to its demand charge proposal:

555 In the short run, customers can modify their behavior so that their peak usage
556 occurs at the same time as their generation. In the long run, customers can invest
557 in resources that better match the timing of the peak usage. For example, they
558 could install solar panels that are more westerly facing to produce more energy in
559 the afternoon and early evening, which better aligns with the Company’s peak,
560 providing more benefit by reducing overall demand. (Steward 449-454)

561 However, these suggestions don't recognize real world realities. Does the Company
562 really believe that rooftop solar customers should stay home during the middle of the day
563 in order to do laundry, dishes, vacuum, cook, and dry their hair simply to use self-
564 generated energy during peak solar generation hours? Few customers have the flexibility
565 in their schedules to do so. Does it really make sense to shift consumption to the middle
566 of the day when utility costs are higher for everyone, rather than the middle of the night?
567 No, because that would increase demand during an already high-load period. DSG
568 excess energy exports would be better used to reduce overall load during this time.

569 And in the long run example, is the Company suggesting that customers re-orient their
570 homes so that the roof itself faces more westerly? Or to prop up one side of each panel to
571 face somewhat more westerly (necessitating spreading out the panels to accommodate the
572 shading that will now take place)? These suggestions are nonsensical and demonstrate at
573 best a lack of understanding and at worst a contempt for its retail customers that install
574 rooftop solar systems.

575 Indeed, the National Association of Regulatory Commissioners (NARUC) discusses the
576 advantages of demand charges:

577 Theoretically, one of the main advantages of demand charges seems to be the
578 greater revenue certainty, especially for certain forms of non-coincident rates,
579 which improves the chances for full recovery of a utility's authorized return. This
580 is mainly due to the costs being recovered based on individual peaks, which are
581 relatively inelastic as compared with the overall volume of usage, which can vary
582 greatly from year-to-year, largely due to weather, energy efficiencies and building
583 standards, and customer behavioral changes. In this way, these rates can reduce
584 risk for the utility.¹⁴

¹⁴ NARUC DER Manual, November 2016, page 102, footnotes excluded.

585 Therefore, it seems the use of demand charges is good for utility revenue stability and
586 reduced risk, but not so good for the customer with relatively inelastic demand.

587 **Q. Has the Company proposed how it will educate its customers about the new rate**
588 **structure and opportunities for responding and reducing bills?**

589 A. No. This is an important point. RMP has set forth no plan for educating its customers that
590 would be subject to these new charges about how to respond in order to both reduce their
591 bills and utility costs beyond a vague statement that “[t]he Company will work with
592 interested parties to develop information for Schedule 5 customers to help them
593 understand the rate structure and how changes in their usage will influence their bill”
594 (Steward 598-600) and noting its belief that rooftop solar customers “are typically more
595 sophisticated energy customers.” (Steward 430-431). This contention is also without
596 evidentiary support.

597 NARUC notes “[o]pponents and proponents of demand charges both agree that
598 significant customer education is key if implementing these rates and that regulators
599 should employ pilot programs or shadow billing over a multi-year rollout.”¹⁵

600 RMI¹⁶ points out that “[w]hile it’s possible that, if customers are sufficiently educated
601 about a demand charge rate, they will reduce peak demand in response, no reliable
602 studies have evaluated the potential for peak reduction as a result of demand charges.”

603 **Q. Aren’t demand charges in common use today?**

¹⁵ Id. page 99.

¹⁶ A Review Of Alternative Rate Designs Industry Experience With Time-Based And Demand Charge Rates For Mass-Market Customers; Rocky Mountain Institute, p. 76, May 2016
download at: www.rmi.org/alternative_rate_designs


604 A. Not for residential customers. Demand charges have historically been applied to large
605 commercial and industrial customers, but very rarely and generally only voluntary for
606 residential customers. RMI (2016) identified only 25 demand charge rates offered to
607 residential customers, and none of them were large investor-owned utilities implementing
608 mandatory demand charges for residential or small commercial customers.

609
610 Many such large commercial and industrial customers are served through a single meter,
611 and often a dedicated transformer or transformer bank. For very large industrial
612 customers, there is typically a dedicated distribution circuit or even distribution
613 substation. For these larger customers, load diversity, i.e. the differences in timing of the
614 use of electrical equipment, occurs on the customer's side of the meter, such as when
615 copiers, fans, compressors, and other equipment cycles on and off in a large office
616 building. Additionally, larger customers frequently have facility managers whose job is to
617 assure facility costs are minimized, including utility costs (energy, water, gas, etc.).

618 For residential consumers, there is also load diversity – but it occurs on the utility's side
619 of the meter as customers in different homes and apartments connected to the same
620 transformers and circuits use power at different moments in time. The point is that the
621 type of rate design that is appropriate for industrial customers, who may have a dedicated
622 substation or circuit and individuals dedicated to minimizing costs and therefore
623 managing industrial or commercial processes, is not necessarily appropriate for
624 residential customers who share distribution components down to and including the final
625 line transformer.

626 For example, because many apartments are served through a single transformer and meter
627 bank, what actually matters to system design is not the individual demands of each
628 apartment, but the combined (diversified) loads of the building or complex. **Figure 2**,
629 below, shows how the sum of individual apartments' maximum hourly demands in one
630 apartment building (in the Los Angeles area) compares to the combined maximum hourly
631 demand for the complex:

632 **Figure 2: Individual vs. Grouped Demand Total**

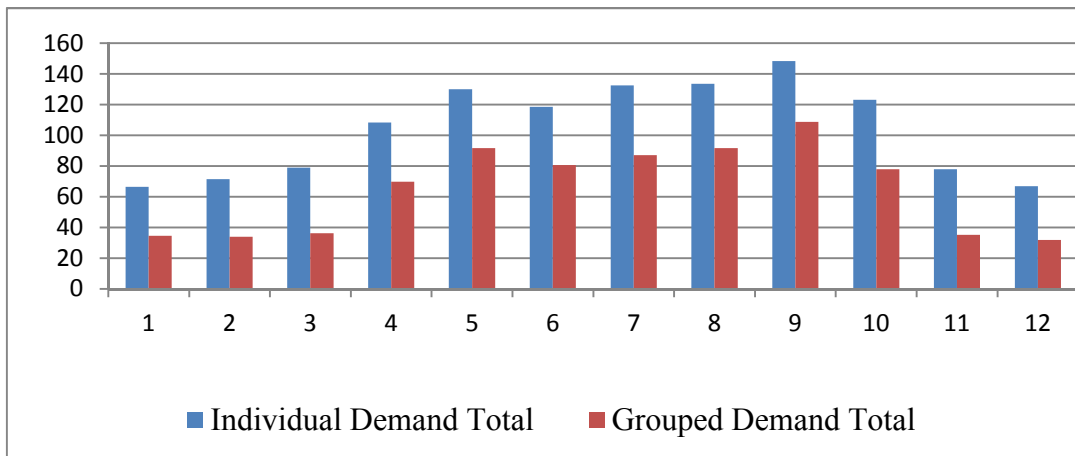

633

634

Source: RAP Demand Charge Webinar, Dec. 2015

635 **Q. Are demand charges an appropriate rate design for residential customers of any**
636 **type?**

637 A. No. Imposition of demand charges on residential customers runs counter to the
638 ratemaking principles of simplicity, understandability, public acceptability, and
639 feasibility of application.

640 Also, demand charges are not tied to cost causation, in that there is no evidence that
641 demonstrates a one-hour demand charge, even one limited to the 100 defined peak hours,
642 has any effect on the actual system peak. As NARUC puts it: "Demand charges

643 themselves can represent significant cost shifting, so regulators should be extra cautious
644 in their development and implementation, ensuring they understand the implications of
645 the charges for their jurisdictions and the rate's advantages (and disadvantages) over
646 alternatives."¹⁷ It summarizes considerations of demand charges as follows:

647 Finally, as mentioned before, regulators should be cautious if implementing
648 demand charges to protect a utility's revenue recovery for the distribution grid is
649 the goal, especially if the DER benefits to the grid are not accounted for in any
650 way. In the example of combining demand charges with an NEM rate, the
651 regulator may simply be layering one proxy, or imperfect solution, over another
652 without addressing the underlying threats and opportunities for their distribution
653 system. Implementing large or non-coincident peak demand charges for an entire
654 residential or small commercial rate class to counter perceived cost shifting from
655 a limited set of actors would most likely be a disproportional response if adoption
656 rates are low or under, say, 10 percent. (NARUC 2016, p. 108)

657 Without the ability to effectively respond to the demand price signal, the demand charge
658 simply becomes another fixed charge, about which the customer can do little. This
659 explains why the Company notes that the structure will reduce the likelihood that system
660 costs will be under-recovered¹⁸ – because the rooftop solar customer would continue
661 paying costs for which it is no longer responsible.

662 **Q. Are there other rate designs and structures that would be more effective in**
663 **connecting customer load characteristics with utility cost causation?**

664 A. Yes. Rates that differentiate between on and off-peak periods in total, i.e. time-of-use
665 rates, provide better and more effective price signals. RMI indicates that time-varying
666 energy charges are more effective at reducing peak demands than are demand charges.
667 (RMI 2016) Additionally, the Brattle Group reported a peak load reduction of less than

¹⁷ NARUC 2016, pages 98-99.

¹⁸ Steward 436-438.

668 2% for residential demand charges, compared with reductions as great as 40% for critical
669 peak pricing time-varying energy rates.¹⁹ Thus, if the goal of a new rate design is to
670 provide more effective price signals, i.e. signals that are actionable by the customer while
671 being tied to cost causation, TOU rates fit the bill far better than demand charges.

672

673 **VOTE SOLAR PROPOSAL FOR RATE DESIGN AND COMPENSATION FOR**
674 **ROOFTOP SOLAR CUSTOMERS OF RMP**

675 **Q. Please explain Vote Solar’s residential rooftop solar compensation and rate design**
676 **proposals.**

677 A. Vote Solar proposes to segment the residential rooftop solar customers of RMP based on
678 the vintage of each customer’s interconnection application (“Application”), treating each
679 group in accordance with the cost recovery concerns that have been raised by RMP about
680 the recent rapid growth of residential rooftop solar, while maintaining fair treatment of
681 current customers and a sustainable market.

682 I propose to divide residential rooftop solar customers into three distinct categories based
683 on the date of application. The first group would be current customers, defined as those
684 who have submitted or will submit, an Application on or before a date that is subsequent
685 to the final order in this proceeding. Given the hearing dates in this proceeding and
686 allowing time for the Commission to issue an Order and the clock to run on requests for
687 reconsideration, I recommend a cutoff date of December 31, 2017. The second group I
688 identify as transitional customers and define as those who submit an Application after

¹⁹ Presentations of Ahmad Faruqui and Ryan Hledik, EUCI Residential Demand Charge Summit, 2015.

689 December 31 of this year, but on or before December 31 of 2024. The third group are
690 those I refer to as future customers who submit an Application after December 31 of
691 2024.

692 **Q. What treatment do you propose for the first group of current customers, i.e. those**
693 **who submit an Application on or before December 31, 2017?**

694 A. In recognition of the benefits already provided to the grid by current customers, some of
695 whom have been rooftop solar customers for as long as 15 years, Vote Solar proposes
696 that these current customers continue to operate under the current net metering regime
697 per Electric Service Schedule 135. In other words, each customer would remain on its
698 existing residential rate (Schedule 1, 2, or 3), and would be able to net excess generation
699 against future consumption within the billing period. Any net excess generation
700 remaining at the end of the month would carry forward to the following month and offset
701 the customer's consumption in that month. Once each year, at the end of March, net
702 excess generation would be zeroed out.

703 **Q. How long would these customers be able to remain on Schedule 135?**

704 A. The period for which current customers would remain on Schedule 135 is 20 years, i.e.
705 until December 31, 2037. While this period is well below the life of the typical PV
706 system, it should be long enough to accommodate the payback period for most
707 customers. Indeed, those customers that submitted their Application several years ago
708 when prices of rooftop solar resources were higher would get the benefit of a longer
709 period of time under the Schedule 135 regime.

710 **Q. How does Vote Solar’s proposal for current customers compare with the proposal of**
711 **RMP?**

712 A. Our proposal is similar to that of the Company, with the exception of the cutoff date and
713 the length of time a current customer could remain on Schedule 135. RMP addressed
714 current customers as follows:

715 The Company supports keeping the current net metering customers on the
716 existing net metering program and their current rate schedule. We acknowledge
717 that current customers made investments based on the current structure and
718 respect the customers' need for reasonable certainty for recovery of their
719 investments. The Company expects this issue to be considered in a future
720 proceeding.²⁰

721 The Company also notes that transitioning current customers to a new schedule would be
722 operationally and administratively challenging given that these customers generally do
723 not have meters capable of billing under the proposed rate structure.

724 **Q. What treatment do you propose for the next group of customers, i.e. those who**
725 **submit an Application after December 31, 2017?**

726 A. For the transitional group of customers, those customers that submit an Application after
727 December 31, 2017 but before December 31, 2024, I propose the following:

- 728 ○ Remain on their existing residential rate schedule 1, 2, or 3 applicable to all [net]
729 *deliveries* of energy from RMP;
- 730 ○ Exports from the transitional customer be netted *within* the billing month against
731 consumption;

²⁰ Hoogeveen, 224-228.

732 ○ Net exports at the close of the monthly billing period compensated at a rate that
733 declines as penetration of rooftop solar within the residential class increases.

734

735 **Q. Why would transitional customers remain on their current rate schedule?**

736 A. RMP has not demonstrated that rooftop solar customers have significantly different usage
737 characteristics than do non-solar customers, nor that solar customers are not paying their
738 full cost of service for their deliveries, or at least as much as the non-solar customers are
739 paying. Additionally, RMP has not shown any incremental costs resulting from the
740 deployment of rooftop solar to date for which rooftop customers are not paying. Thus,
741 despite assertions from RMP to the contrary, there are no additional costs nor is there a
742 cost shift to be addressed by segregating residential solar customers into their own rate
743 class.

744 **Q. Please describe your proposal for exported energy from residential rooftop solar**
745 **systems.**

746 A. In discussions with the Company and other parties, I have heard the concern that net
747 excess energy generated in one month, or a series of months, should not be carried
748 forward to another season. For example, some have expressed the view that excess
749 energy generated in the spring when loads and energy prices are generally lower (and
750 solar generation is above average), should not be credited against summer loads when
751 energy costs are higher.

752 While I believe that the amount of residential rooftop solar generation is presently small,
753 and this concern is minor at this point, I recognize that solar penetration is likely to

754 increase over time. In the interest of offering possible solutions to the concerns raised, I
755 suggest that reconciling energy balances monthly instead of annually can mitigate this
756 concern. Therefore, I propose to allow netting of energy only within the billing period,
757 and any net excess energy that remains after such netting be compensated at a rate that
758 recognizes the value of the excess energy.

759 **Q. How do you propose to recognize the value of the monthly net excess energy?**

760 A. Again in the spirit of offering solutions and a means of addressing the concerns raised by
761 RMP regarding the recent rapid growth of residential rooftop solar, I propose a declining
762 compensation rate for net excess energy tied to increases in residential rooftop solar
763 penetration. This type of mechanism will act as a throttle on the growth rates and
764 potentially a limiter on individual system size. While the compensation rates should be
765 supported by and consistent with the value analysis performed by Dr. DeRamus, because
766 the benefits of distributed solar tend to be lumpy, i.e. the savings tend to come in large
767 amounts at discrete times, smoothing the declining compensation rate creates a glidepath
768 to a future sustainable market for both solar and non-solar customers of RMP.


769 **Q. How would you develop a glidepath?**

770 A. The glidepath should begin with current compensation rates, i.e. retail rates, and aim
771 towards a “soft landing” rate that represents the minimum value rooftop solar provides at
772 the maximum NEM penetration allowed. The maximum NEM penetration presently is

773 the Commission’s NEM cap of 20% of the 2007 RMP peak load.²¹ RMP estimates the
774 NEM cap would be reached in 2035.²²

775 The current compensation rate varies depending on the consumption of the customer due
776 to the effect of the tiered pricing system. In order to simplify the calculation, I propose
777 the compensation rate be based on a percentage of the total aggregated retail rate or
778 “TARR” for the residential class as a whole (excluding the revenue associated with the
779 customer charge). The glidepath is depicted for illustrative purposes in **Figure 3**:

780 **Figure 3: Residential Rooftop Solar Capacity Penetration**

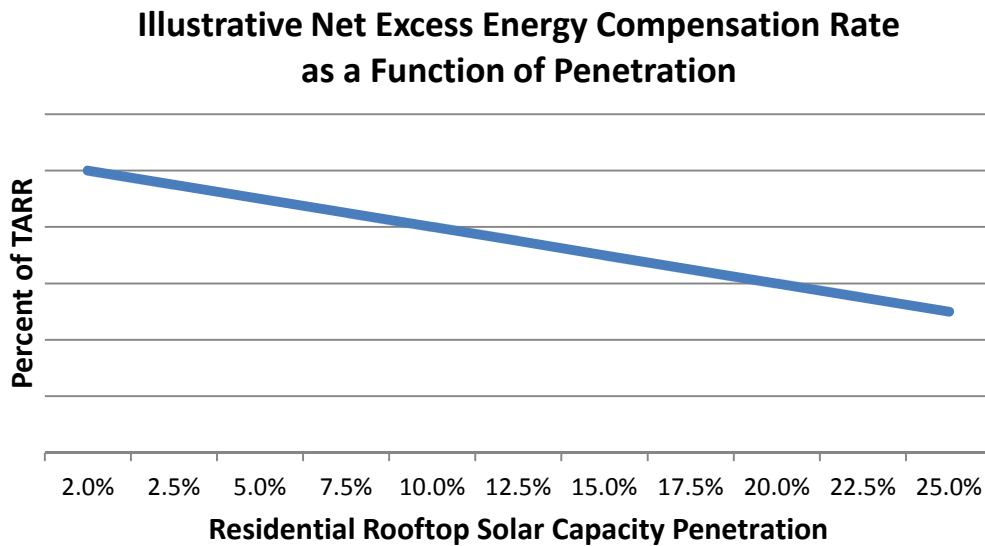

781
782 The final step is to specify discrete steps for rate changes as a function of penetration
783 rates. Larger steps, e.g. 5%, would reduce the number of rate changes required but each
784 change would be somewhat larger, while the granularity of 2.5% steps may help to


²¹ A 2016 NREL Assessment provides another point of reference for solar potential in Utah: The annual generation potential for small buildings is about 25%, Technical Report NREL/TP-6A20-65298, Table 3, January 2016.

²² See testimony of Vote Solar witness Dr. David DeRamus, Figure 1, page 8.

785 minimize fire sale activity in the market. These options are depicted in **Figure 4** and


786 **Figure 5** below:

787 **Figure 4: Illustrative Net Energy Compensation Rate Framework – 2.5% Steps**

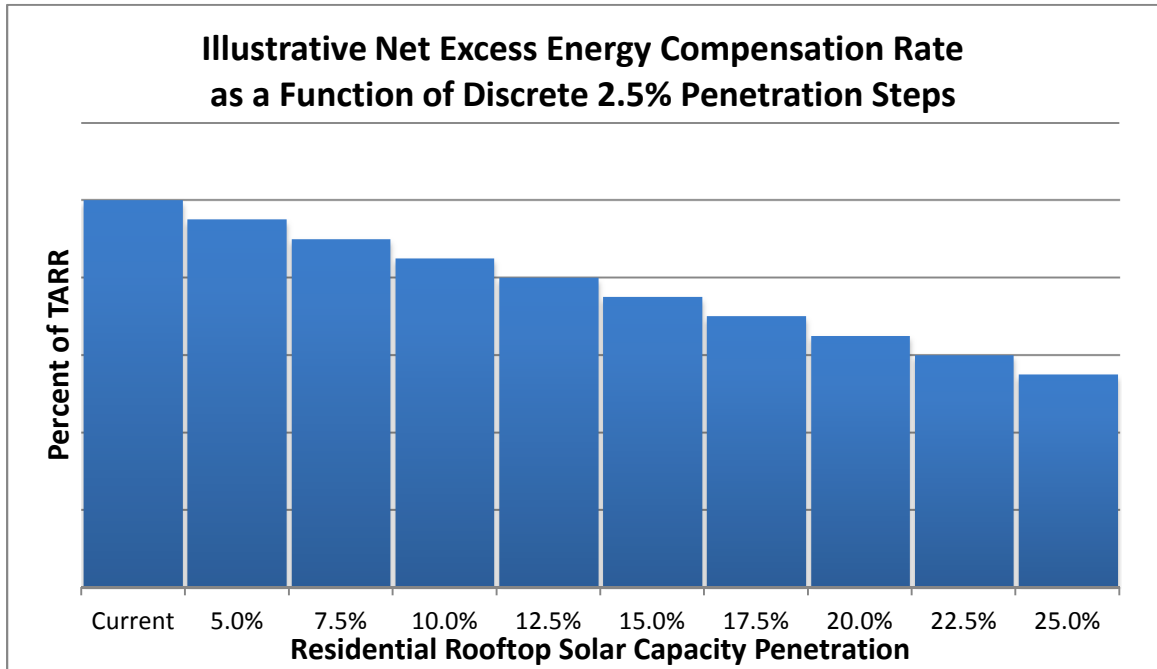

788

789 **Figure 5: Illustrative Net Energy Compensation Rate Framework – 5% Steps**

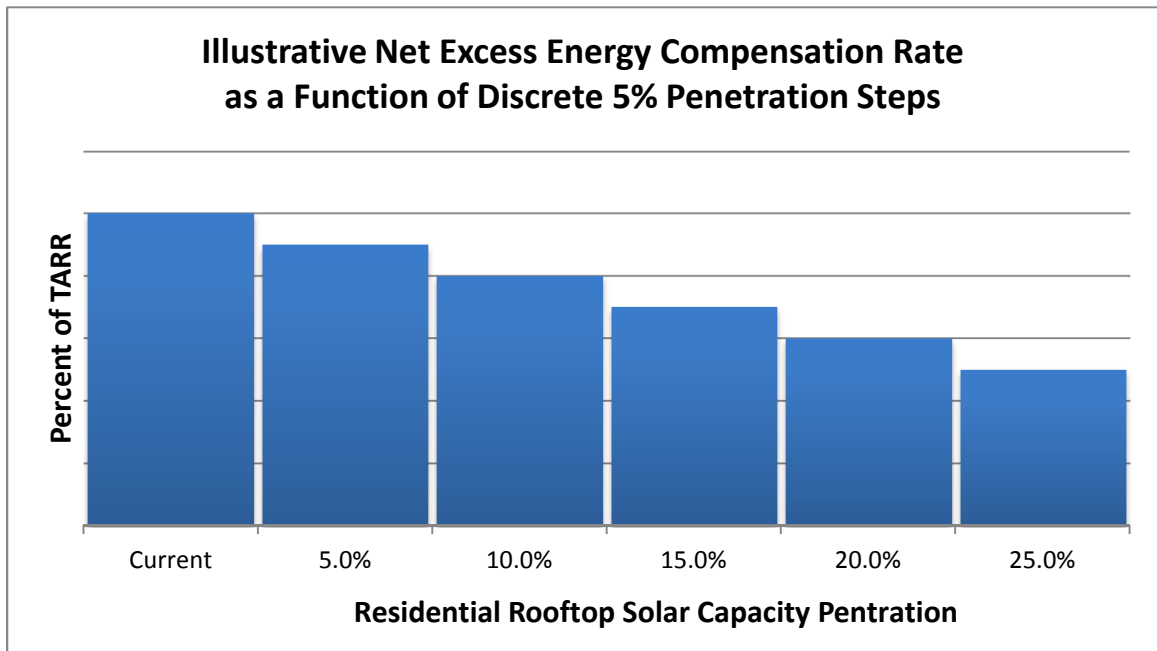

790

791 **Q. How frequently would you adjust the TARR?**

792 A. The TARR would be updated annually by RMP via a brief filing with the Commission on
793 May 1 based upon the prior year's residential revenue and sales. Data from the FERC
794 Form 1 may be used for simplicity and transparency. Upon approval by the Commission,
795 the compensation rates would be adjusted.

796 **Q. Would a transitional customer's compensation rate change over time, as penetration**
797 **thresholds are reached?**

798 A. No. Rooftop solar customers would retain the same percentage of TARR as their excess
799 energy compensation rate.

800 **Q. Do you have any other proposals for the transitional period?**

801 A. Yes. During the transition period, I propose that RMP implement a pilot program to
802 evaluate the effects of a TOU rate structure for residential solar and non-solar customers
803 alike. There are similar pilot programs going on around the country, notably in Colorado,
804 from which RMP can learn.

805 **Q. Please describe the structure of the rates for future residential rooftop solar**
806 **customers.**

807 A. The Company has clearly expressed the desire in its filing to change the current rate
808 structure based upon the effects of reduced consumption. In a nutshell, RMP complains
809 that reduced consumption does not necessarily result in reduced utility costs. Much of the
810 rationale the Company uses to justify its proposed three part rate including demand
811 charges is an effort to reconcile this disconnect between sales and costs. And as pointed

812 out during my evaluation of demand charges herein, rate structures that tie utility costs to
813 time periods achieves the objectives of RMP without the potentially draconian impacts on
814 rooftop solar (or any other) customers.

815 Therefore, I propose a TOU pricing model for future customers. TOU rates, if designed
816 properly, will reduce utility costs as customers consume less during the higher cost on-
817 peak periods. I recommend TOU rates become effective at the beginning of 2025 for
818 future solar customers as well as for non-solar customers. TOU rates provide actionable
819 price signals from which all customers can benefit.

820 While it is too early to provide much specificity to the details of a TOU rate proposal, I
821 recommend the use of tiered energy rates within the temporal blocks of a TOU structure
822 commensurate with the tiered rate that exist currently. This will provide protection for
823 vulnerable customers, e.g. low-income and those on a fixed income, that may not be able
824 to modify their consumption patterns.

825 **Q: Does this conclude your testimony?**

826 A: Yes.